


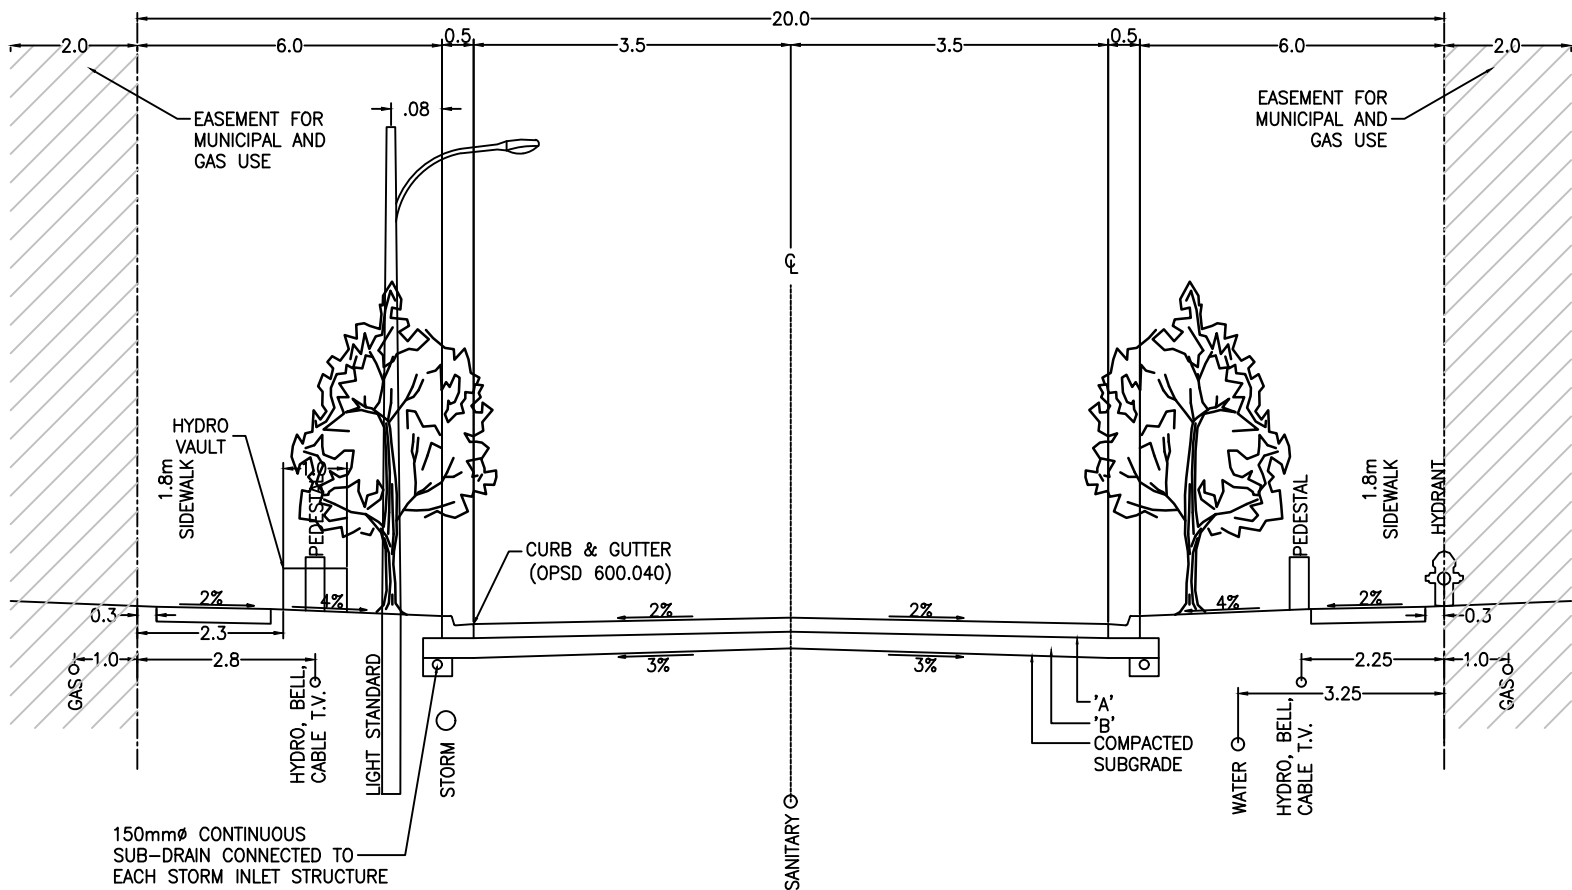

UTILITY	MIN. COVER
SANITARY	2.8
STORM	1.5
WATER	2.0
HYDRO	0.9
BELL	0.76
CABLE	0.76
GAS	0.76

NOTES:

1. REFER TO PAVEMENT DESIGN IN THE 3. ENGINEERING MANUAL FOR MINIMUM PAVEMENT THICKNESS.
2. WHERE THE SOILS CONSULTANT'S RECOMMENDATIONS EXCEED MINIMUMS NOTED, THE SOILS CONSULTANT'S RECOMMENDATIONS SHALL BE USED.

3. A MIN. BOULEVARD WIDTH OF 4.5m IS REQUIRED TO ACCOMMODATE A 1.8m WIDE SIDEWALK AND TRANSFORMERS, INCLUDING THEIR REQUIRED GROUNDING GRID. COORDINATION WITH ENOVA POWER CORP. IS REQUIRED FOR ALL NEW HYDRO INSTALLATIONS.

SCALE: NTS

4. WHEN MULTI-USE PATHS ARE PROPOSED, THE LOCATION OF UTILITIES WILL NEED TO BE REVISED AND COORDINATED WITH THE LOCAL UTILITY PROVIDERS ON A CASE BY CASE BASIS.

ALL DIMENSIONS IN METRES UNLESS OTHERWISE SHOWN